



ZW32-24/630-20 Catalogue

Outdoor high vacuum circuit breaker



For Reliable, Secure and Economical Energy System Operation

Dongfang Electronics International Engineering Co., Ltd.

Dongfang Electronics Co., Ltd.

1. General Overview


1.1 Application

&RPSRVLWLRQ DQG PHDQLQJ RI WKH SURGXFW

(QYLURQPHQWDO FRQGLWLRQV RI XVH

1R	1DPH	8QLW	6WDQGDUG SDUDPHWHUV
	0D[LXPX WHPSHUDWXUH		
	\$PELHQW DLHZHVW 7HPSHUDWXUH		
	WHPSHUDWXUH XLPXP GDLO\ WHPSHUDWXUH		
	GLIIHUHQFH		
	(OHYDWLRQ	P	"
	6RODU UDGLDWLRQ LOWHQVLW\	RXWGRRU	: FP
	)LOWK OHYHO		á
	7KLFNQHVV\ RI LFH FRYHP		
	:LQG VSHHG ZLQG SUHVXUH RXWGRRU		P V 3D
	\$YHUDJH GDLO\ UHODWLYH		"
	+XPLGLW\ KXPLGLW\		
	\$YHUDJH PRQWKO\ UHODWLYH		"
	KXPLGLW\		
	(DUWKTXDNH +RUL]RQWDO		
	UHVLRQW DFFHOHUDWRQ YHUWLFDO	J15g	
	FDSDFLW\ DFFHOHUDWRQ		
	6LQH UHVRQDQW WULSOH ZDYH ZLWK VDIHW\		

1.4 Equipment size

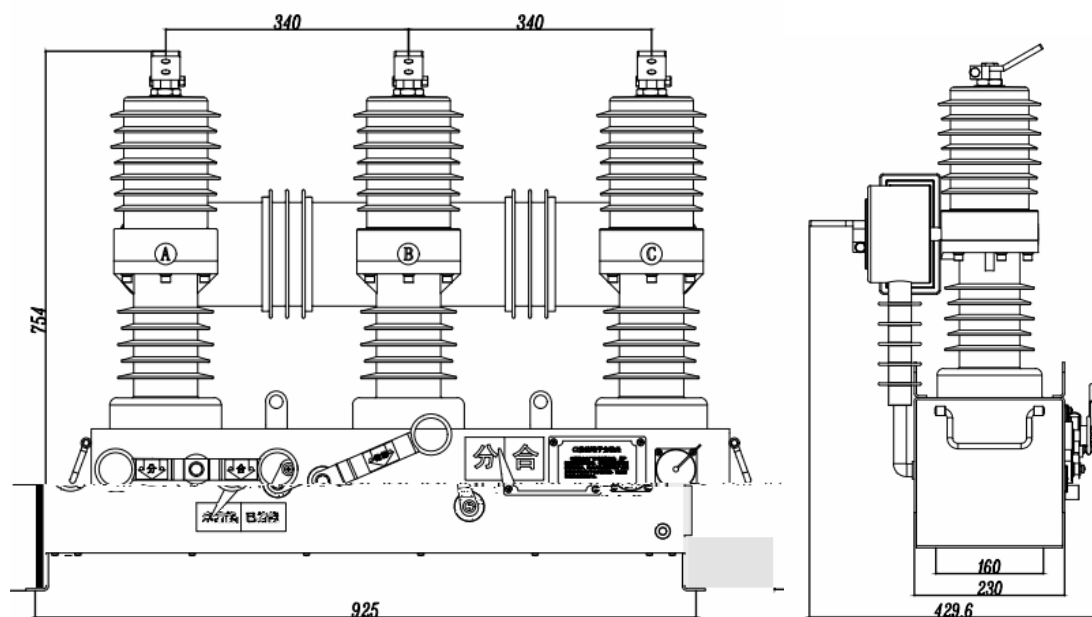

1.5 Main technical parameters

[illegible][illegible]

2. Basic components

2.1 Vacuum interrupter

2.2 Operating mechanism

2.3 Current Transformer

3. Features


4. Installation and commissioning

4.1 Lifting of equipment

4.2 Fixing of equipment

4.3 On-site installation guidance

Installation schematic

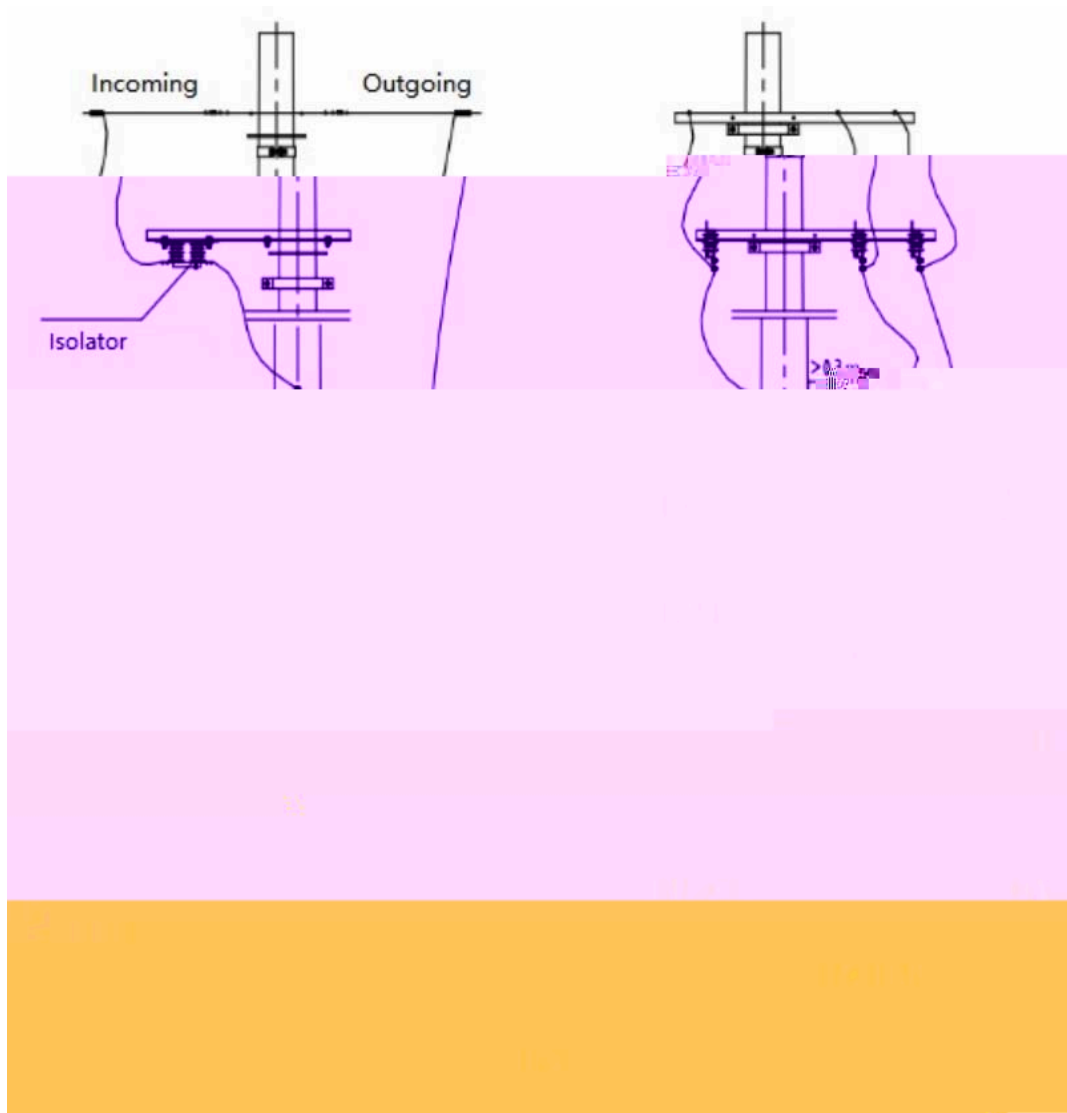

4.4 Field trials

Insulation withstand voltage test

A.) Test 1 to ground operating procedures:

B.) Test 2 interphase operating procedure:

C.) Test 3 fracture operation procedure:

5. Application and Maintenance

"WARNING"

Application

Dongfang Electronics International Engineering Co., Ltd.

Dongfang Electronics Co., Ltd.

Address: 2 Jichang Road, Yantai, Shandong Province, P.R. China, 264000

Tel: +86-535-5520925

Fax: +86-535-5520930

Email: idf@dongfang-china.com

Website: <http://www.dongfang-china.com/en>



THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE PROPERTY OF DONGFANG ELECTRONICS INTERNATIONAL ENGINEERING CO., LTD. ALL RIGHTS RESERVED.